



Operations Report: Otter Rock Water District

August 2026

Base Operations

1. 08/21 - Meter read system (data transmitted to OWRD same day)

Spring flow – July 23, 2026

Source	Flow rate GPM
Spring 1 flow rate	26
Spring 2 flow rate	24
Spring 3 flow rate	31
Reservoir overflow rate	30

Spring flow – August 21, 2026

Source	Flow rate GPM
Spring 1 flow rate	21
Spring 2 flow rate	16
Spring 3 flow rate	30
Reservoir overflow rate	50




Distribution Overview (August 2026)

Master Meter Usage: 834,000 gallons

Distribution Loss: 94,595 gallons

Loss Factor: 11.34%

Gallons per minute loss: 2.12 GPM

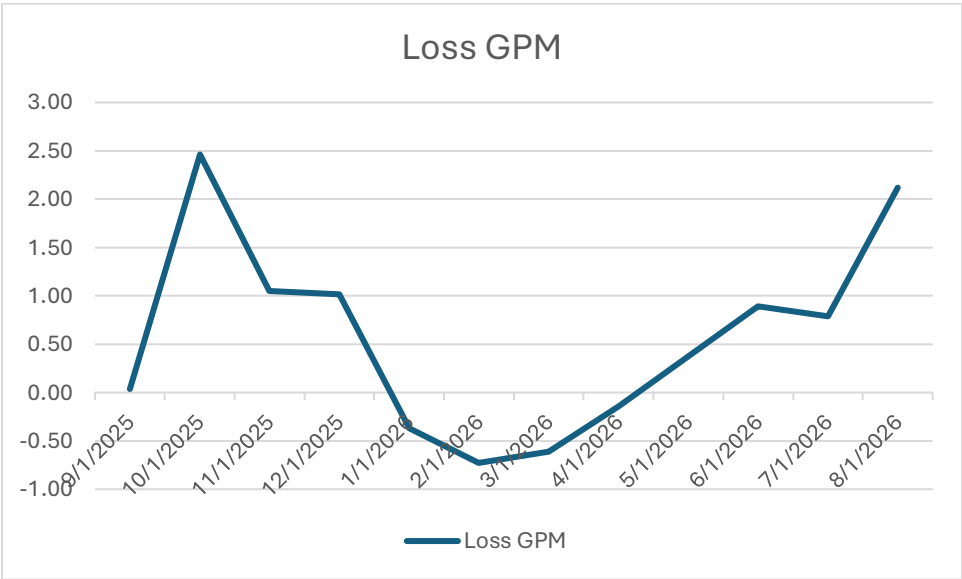




Compliance Analysis

Samples Collected:

08/18 – Monthly Routine Coliform

Chlorine levels

	First User	Distribution System
Average	0.31 ppm	0.30 ppm
High	0.42 ppm	0.38 ppm
Low	0.22 ppm	0.20 ppm

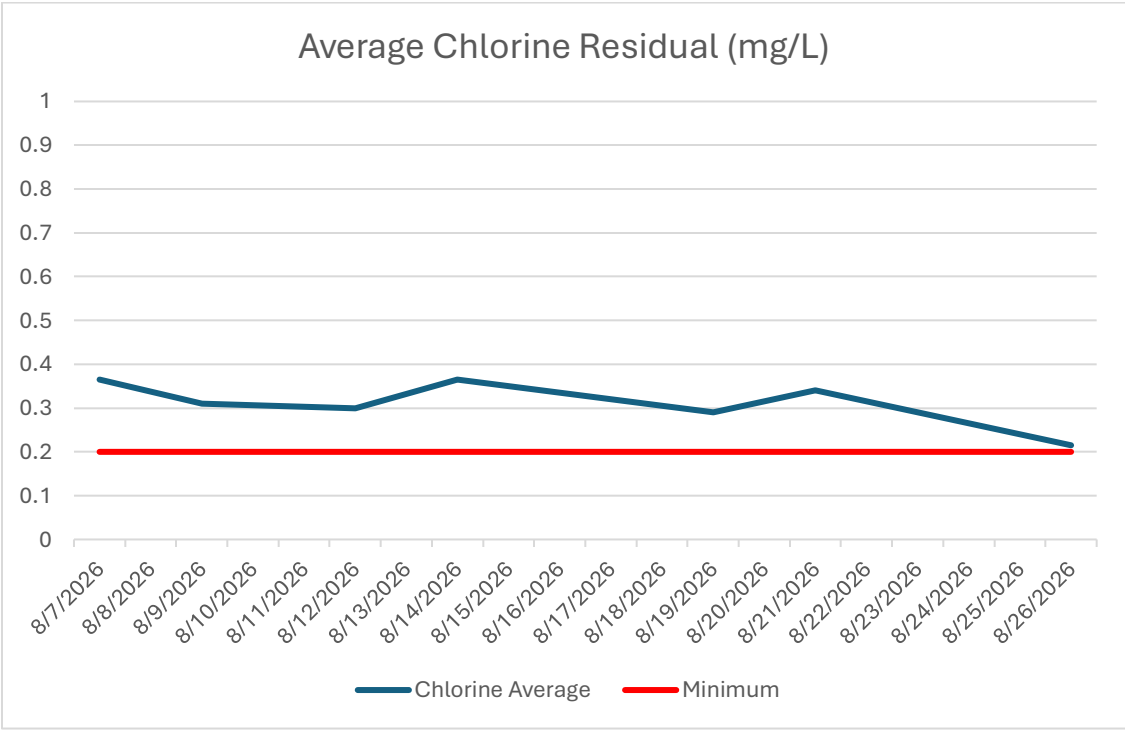



NW Natural
WATER™

Additional Services

08/13 – Locate at 330 1st St

Recommended Maintenance

Install air relief valves in the distribution system to prevent the air lock from occurring again. Ensure they are planned for and included in the system's rebuilding.

Administrative Comments

There are past due unpaid balances owed to NW Natural Water Services and the accounting team has not been able to clearly understand if the unpaid balances are due to disputed charges or clerical errors (or both). We kindly request payment or continued conversation if there are billing errors that still need to be corrected.